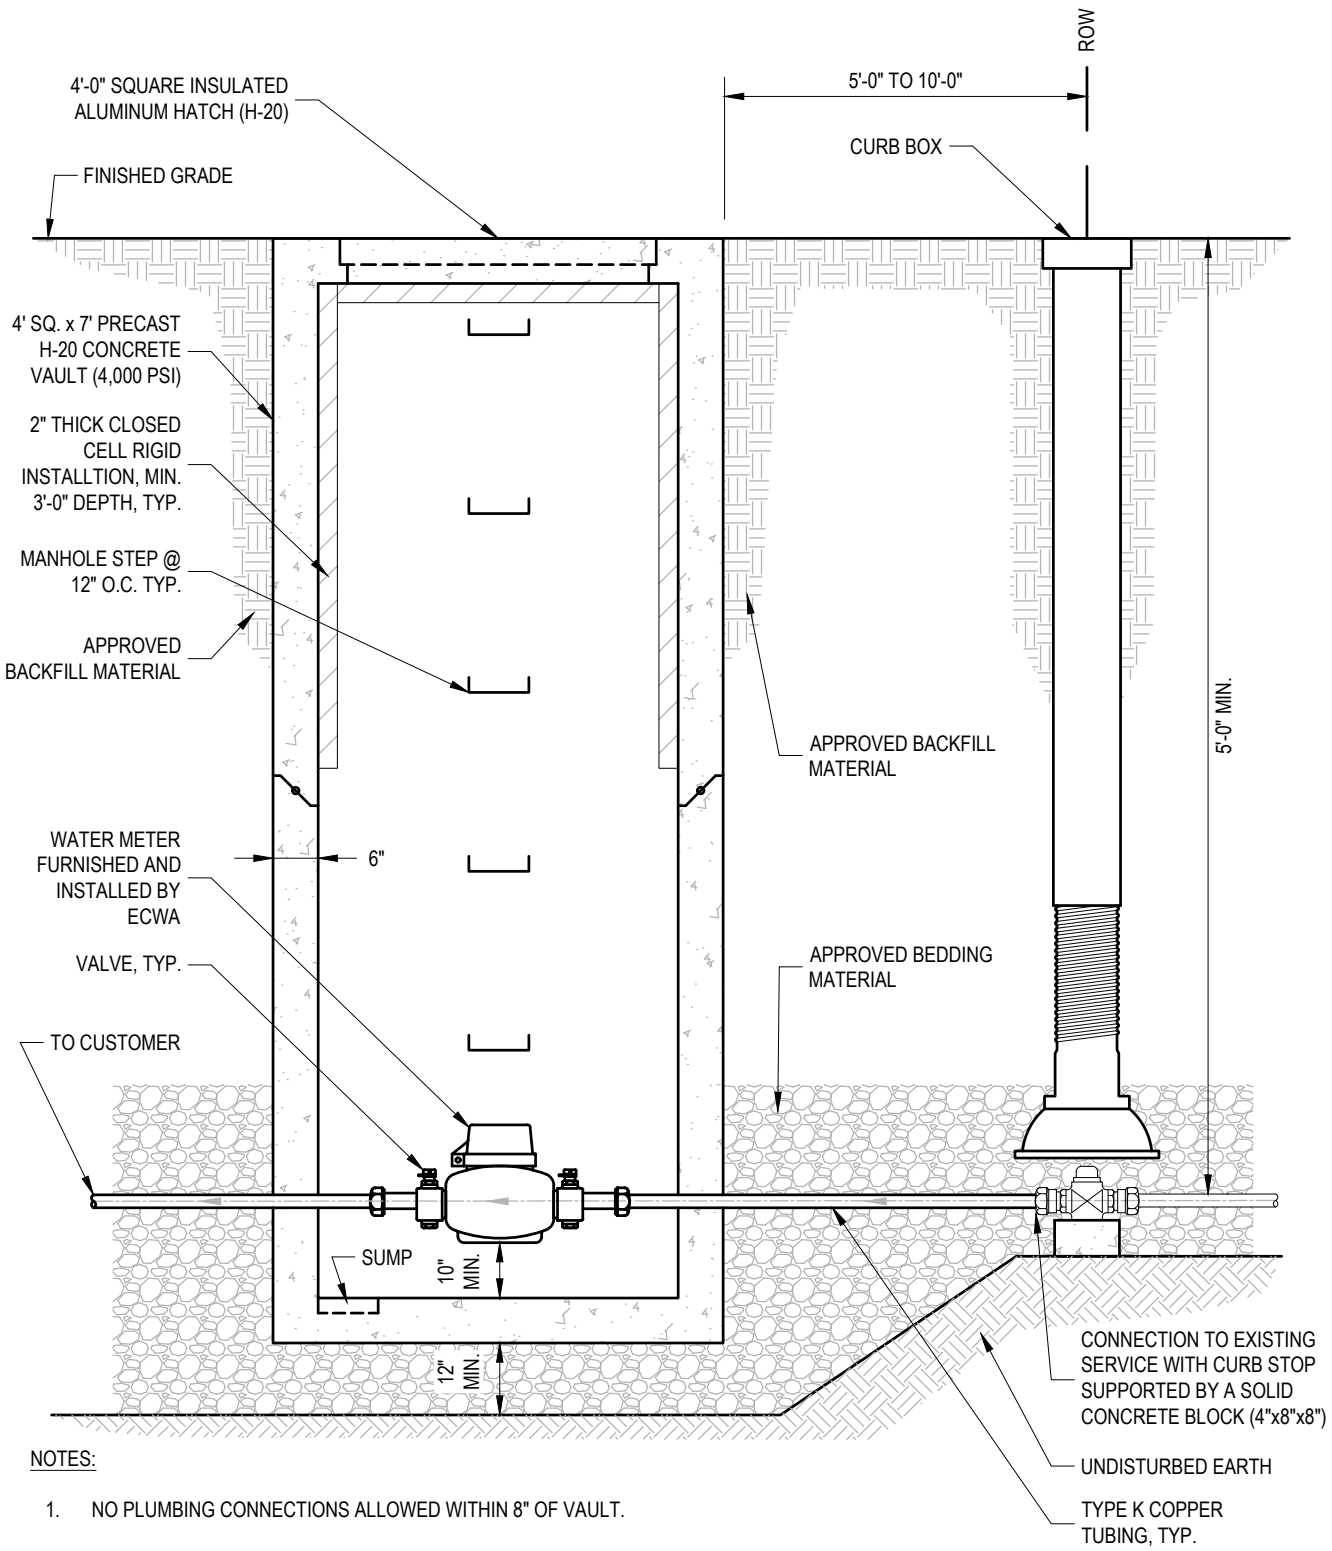

NOTES:

1. NO PLUMBING CONNECTIONS ALLOWED WITHIN 8" OF VAULT.
2. A HOT-BOX LOCATED ABOVE GRADE IS ALSO ACCEPTABLE.

WATER METER VAULT
1.5" AND 2" METERS

SCALE: NTS

Revision: 2024-01

Detail: SD-22