


***NOTES:**

1. THE AUTHORITY RESERVES THE RIGHT TO DETERMINE METER LOCATION.
2. TILE METER SETTING REQUIRED AT R.O.W. IF OVER 150'.
3. 10' MIN. COPPER TUBING TO BE INSTALLED AT CURB STOP FOR PROPER CONNECTION.
4. THE WATER SERVICE PIPE SHALL BE SEPARATED FROM THE BUILDING SEWER BY A MINIMUM OF 5 FEET MEASURED HORIZONTALLY, OF UNDISTURBED OR COMPACTED EARTH OR PLACED ON A SOLID LEDGE AT LEAST 12 INCHES ABOVE AND TO ONE SIDE OF THE HIGHEST POINT IN THE SEWER LINE.

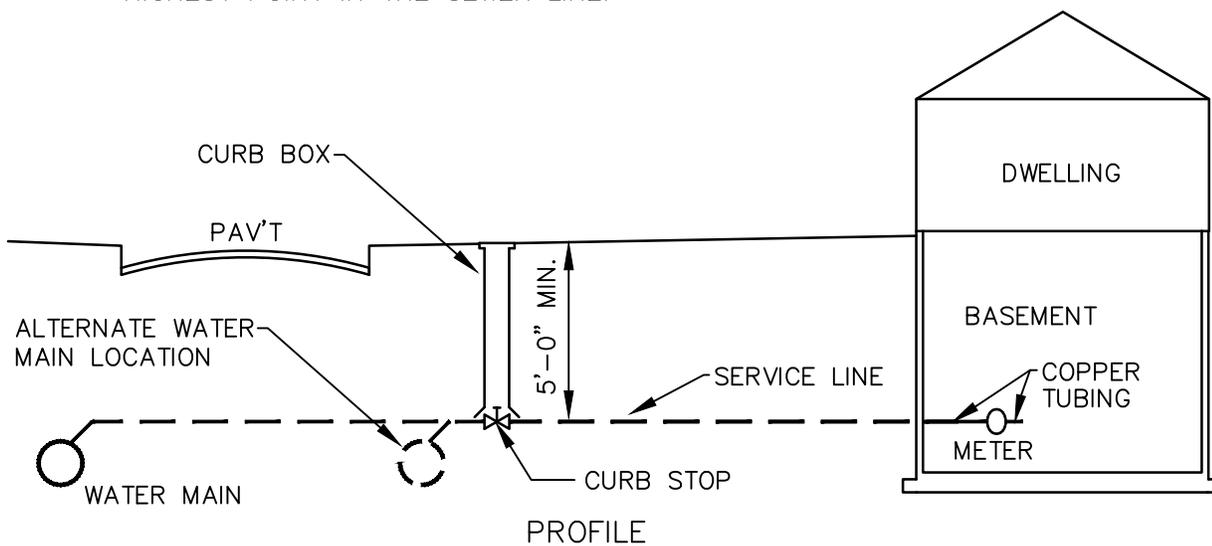

NOTE: COPPER TUBING IS REQUIRED THROUGH THE FOUNDATION WALL AND ON BOTH SIDES OF THE METER. THE COPPER TUBING SHALL BE SECURED ON BOTH SIDES OF WHERE THE METER IS TO BE LOCATED. METER IS TO BE PLUMBED HORIZONTALLY WITH APPROPRIATE CLEARANCE ON ALL SIDES. SPACING WILL VARY DEPENDING ON METER SIZE. CONTACT E.C.W.A. METER SHOP FOR QUESTIONS REGARDING SPACING REQUIREMENTS.

I:\PUBLIC\Engineering\Service Applications\A3-28_SERV_LINE_INSTALL-A

ERIE COUNTY WATER AUTHORITY BUFFALO, NEW YORK	SERVICE LINE INSTALLATION	DWG. NO. A3-28	
		DATE 7/13/59	REVISED 3/22/22